

CONNECTION EXTENSION CABLE

Art. No.: E013013-01; E013013-02; E013013-03 or E013013-04 for buffer sensors T4/T6/T7, for example.

A twisted pair (white/brown, green/yellow or gray/pink) must always be used for the temperature sensor cable. This means that up to three sensors can be extended.

A PT1000 is a temperature sensor whose resistance value changes; it does not matter whether, for example, white is connected to white and red to brown or vice versa.

The shield cable (black) must be connected to a PE connection, for example pin 4/yellow on the 4-pin bus connector (pellet module) of the EOS.



The cable for the T1/T3 Ni-Cr-Ni thermocouples cannot be used. The compensating cable is still required here.

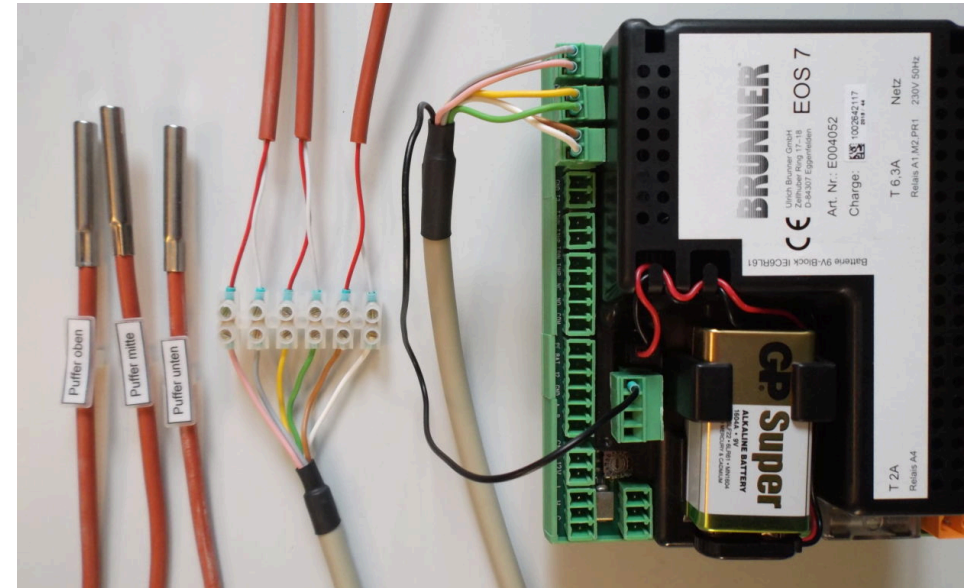


Illustration 1: Connecting the extension cable to an EOS 7

Ulrich Brunner GmbH
Phone: +49 (0) 8721/771-0

Zellhuber Ring 17-18
E-mail: info@brunner.de

D-84307 Eggenfelden
Internet: www.brunner.de