

BRUNNER WATER BOILERS






Kompakt-Kessel B8

State: 2023-09-11






BRUNNER[®]
made in germany.

Dimension sheets - Kompakt-Kessel B8

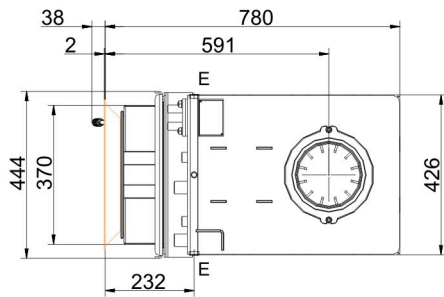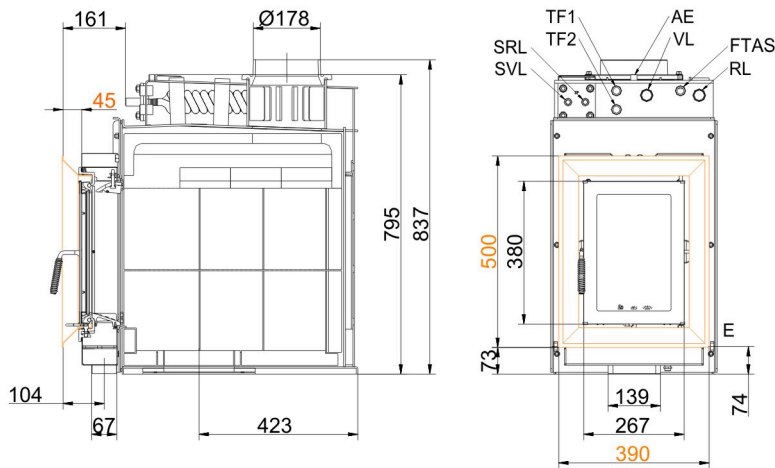

- VL supply 1" ext. th.
- RL return boiler 1" ext. th.
- E drain 1/2" int. th.
- SVL supply cooling pipe outlet ext. th.
- SRL return cooling pipe outlet 1/2" ext. th.
- FTAS socket for thermal safety sensor int. th.
- TF1 socket 1/2" for sensor int. th.
- TF2 socket 1/2" for sensor int. th.
- AE socket 1/2" for ventilation


... with steel door frame

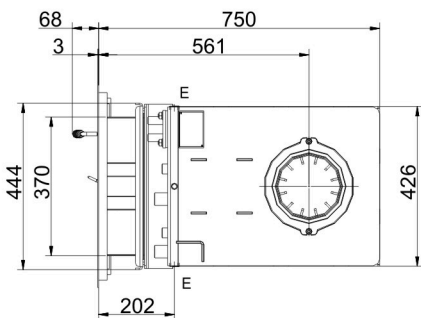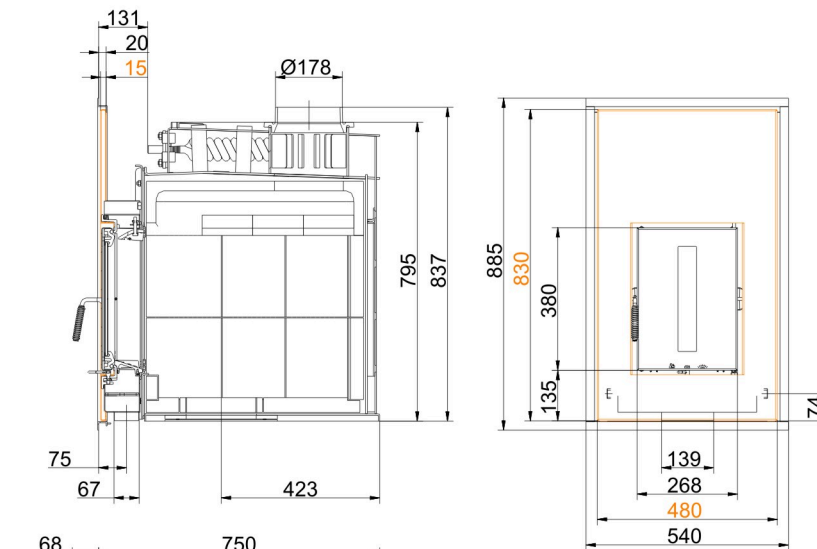

- VL supply 1" ext. th.
- RL return boiler 1" ext. th.
- E drain 1/2" int. th.
- SVL supply cooling pipe outlet ext. th.
- SRL return cooling pipe outlet 1/2" ext. th.
- FTAS socket for thermal safety sensor int. th.
- TF1 socket 1/2" for sensor int. th.
- TF2 socket 1/2" for sensor int. th.
- AE socket 1/2" for ventilation


... with steel front plate

Dimension sheets - Kompakt-Kessel B8

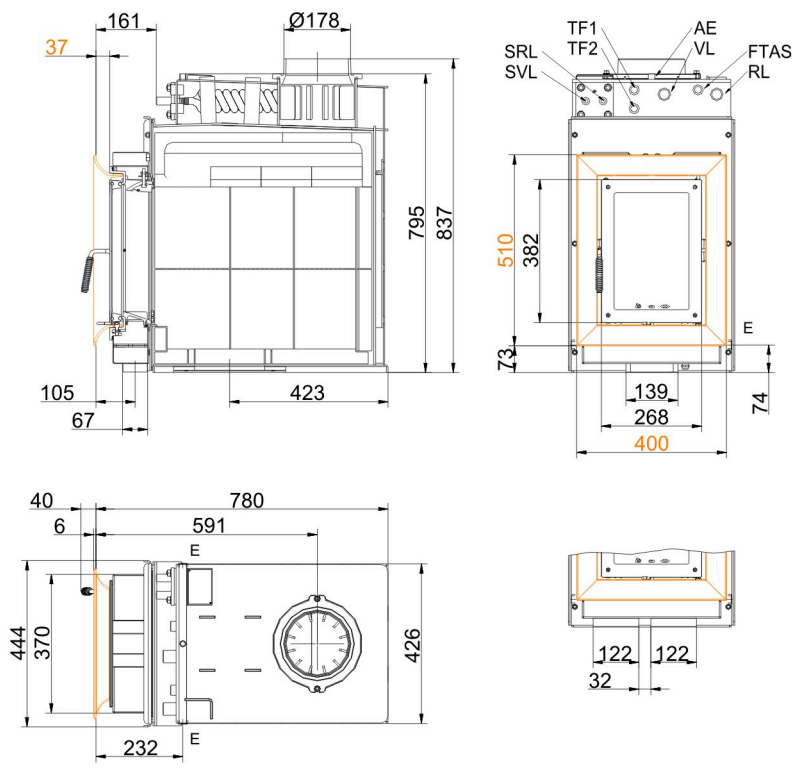

- VL supply 1" ext. th.
- RL return boiler 1" ext. th.
- E drain 1/2" int. th.
- SVL supply cooling pipe outlet ext. th.
- SRL return cooling pipe outlet 1/2" ext. th.
- FTAS socket for thermal safety sensor int. th.
- TF1 socket 1/2" for sensor int. th.
- TF2 socket 1/2" for sensor int. th.
- AE socket 1/2" for ventilation


... with cast iron frame

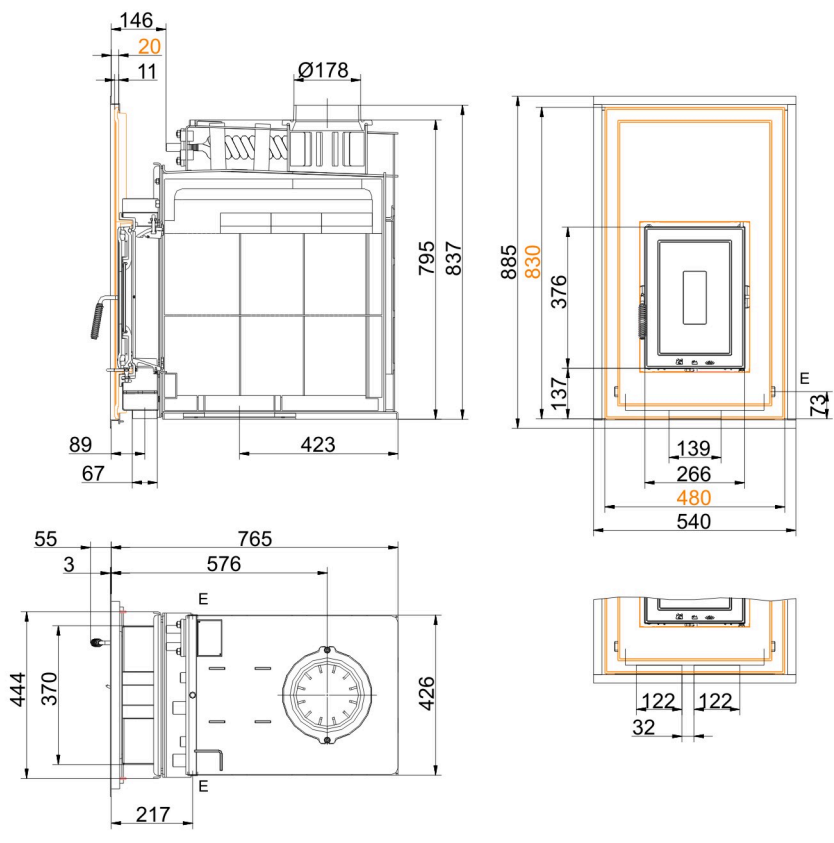

- VL supply 1" ext. th.
- RL return boiler 1" ext. th.
- E drain 1/2" int. th.
- SVL supply cooling pipe outlet ext. th.
- SRL return cooling pipe outlet 1/2" ext. th.
- FTAS socket for thermal safety sensor int. th.
- TF1 socket 1/2" for sensor int. th.
- TF2 socket 1/2" for sensor int. th.
- AE socket 1/2" for ventilation

... with cast iron front plate

Dimension sheets - Kompakt-Kessel B8

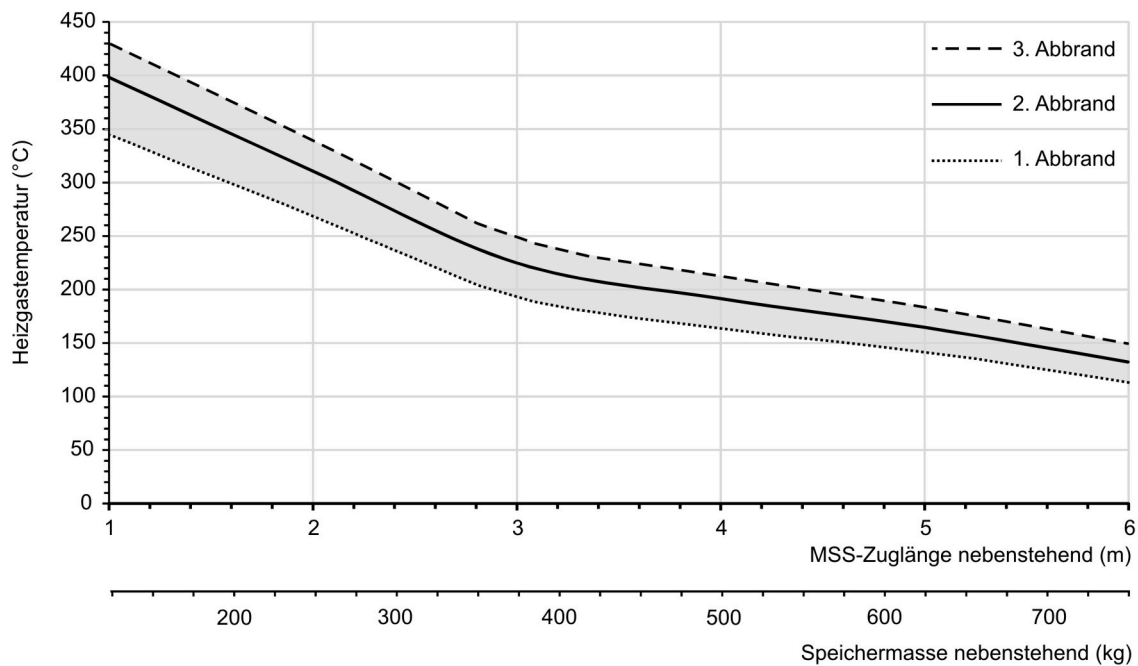

We suggest for CAD planning Palette CAD. Permanent updated drawings: www.brunner.de
Frames/ flue gas outlet connection/ combustion air supply connection/ front variants/ support bearing are marked in color.

Planning and installation - Kompakt-Kessel B8

Tested according to		EN 13229 W	EN 13229 W
Values measured at		Rated power	Practical avg.
Data for functional demonstration			
Rated heat power	kW	13	-
Fire wood volume	kg/h	3.8	5.3
Combustion performance	kW	15.8	22.5
Flue gas mass flow	g/s	11.3	18.9
Outlet temperature (before reheating surface)	°C	498	520
Flue gas temperature after:			
1 x adjoining cast iron radiator (GNF 8/10)	°C	181	241
4,9 m ceramic accumulator ¹⁾	°C	-	180
3,4 m accumulation stones (MSS) ¹⁾	°C	-	210
Necessary supply pressure	Pa	12	15
Combustion air consumption	m ³ /h	35	45
Combustion air connection Ø	mm	125	125
Heating gas temperature (before the hood/dome variant)			
insert flue outlet nozzle	°C	498	520
Heat distribution			
Insert / reheating surface	%	12 / 45	12 / 45
Glass pane (single / double)	%	- / 10	- / 10
Boiler	%	33	33
Boiler part without insulation, double glass	%	33	33
Cross-section of gratings ²⁾			
Convection air	cm ²	200 / 250 / 550	200 / 250 / 550
Supply air	cm ²	200 / 250 / 550	200 / 250 / 550
Minimal distances of the fireplace			
to cladding, insulation layer	cm	6	6
to mounting floor	cm	15	15
Thermal insulation without / with air gratings ³⁾			
Mounting wall	cm	10 / 7	10 / 7
Floor	cm	0 / 0	0 / 0
Ceiling	cm	16 / 12	16 / 12
Brick lining for combustible wall	cm	10	10
Water boiler data			
Max. operating pressure	bar	3	3
Max. flow temperature	°C	100	100
Water volume	liter	42	42
Connections flow / return	inches	1	1
Weight			
Fireplace / combustion chamber	kg	160 / 59	
Meets requirement/limit values for:			
Germany/ Austria / Switzerland / Norway		1.BImSchV (Stufe 2) / 15a BVG (2015) / - / -	

- 1) Approximate value. Determination according to design characteristics for adjacent storage mass or proof of function provided by calculation
- 2) for fireplace inserts / flue gas pipe / metallic reheating surface
- 3) Values determined with upper air cross- sections; stove cladding is heat emitting